

# **Long Island Rail Road Elevator/Escalator**

2025 Annual Report



# 2025 Elevator Availability by Station (Goal 98%)

Branch/Station	Availability	Branch/Station	Availability
<b>BABYLON</b>		<b>PORT JEFFERSON</b>	
Amityville	98.7%	Carle Place A	99.4%
Babylon A1	99.5%	Carle Place B	99.3%
Babylon B1	99.5%	Merillon Ave A	99.5%
Babylon A2	99.4%	Merillon Ave B	99.2%
Babylon B2	99.1%	Hicksville A1	98.4%
Baldwin	99.4%	Hicksville B1	98.9%
Bellmore	99.3%	Hicksville A2	99.6%
Copiague	99.0%	Hicksville B2	99.5%
Freeport	98.9%	Mineola A	99.5%
Lindenhurst	99.1%	Mineola B	99.5%
Massapequa	99.2%	Mineola Garage 1	99.0%
Massapequa Park	99.1%	Mineola Garage 2	98.4%
Merrick	99.5%	Westbury A	99.5%
Rockville Centre	99.4%	Westbury B	99.2%
Seaford	99.3%	Westbury Garage 1	99.2%
Wantagh	99.4%	Westbury Garage 2	98.9%
Saint Albans	99.3%		
<b>PORT WASHINGTON</b>			
Great Neck A	99.0%		
Great Neck B	99.3%		
Auburndale	99.4%		
Murray Hill A	99.5%		
Murray Hill B	99.5%		
Flushing A	99.0%		
Flushing B	99.4%		


# 2025 Elevator Availability by Station (Goal 98%)

Branch/Station	Availability	Branch/Station	Availability
<b>RONKONKOMA</b>		<b>HEMPSTEAD</b>	
Ronkonkoma A	99.1%	Elmont A	99.2%
Ronkonkoma B	99.4%	Elmont B	99.4%
Ronkonkoma C	99.4%	Floral Park A	99.2%
Ronkonkoma Garage 1	99.4%	Floral Park B	99.2%
Ronkonkoma Garage 2	99.5%	Floral Park C	99.1%
Wyandanch Garage 1	99.5%	Queens Village A	99.3%
Wyandanch Garage 2	99.5%	Queens Village B	99.4%
Wyandanch Garage 3	99.6%	<b>CITY TERMINAL</b>	
Wyandanch A	99.3%	Atlantic Terminal 1	99.5%
Wyandanch B	99.4%	Atlantic Terminal 2 (2)	97.1%
<b>LONG BEACH</b>		Jamaica F14	99.4%
Lynbrook A	98.3%	Nostrand Ave A	98.6%
Lynbrook B	99.4%	Nostrand Ave B	99.3%
<b>FAR ROCKAWAY</b>		Woodside 415x	98.7%
Valley Stream	99.8%	Woodside 418x	99.3%
Rosedale	99.5%	Woodside 419x	99.5%
Laurelton	99.2%	Penn 34S-ELV-P34	99.3%
Locust Manor A (1)	95.5%	Penn CEN-ELV-P-7	99.4%
Locust Manor B	99.9%	Penn CEN-ELV-P-8	99.2%
		Penn CEN-ELV-P-9	99.4%
		Penn CEN-ELV-P10	98.1%
		Penn CEN-ELV-P11	99.3%

(1) Locust Manor A – GC warranty repairs

(2) Atlantic Terminal 2 – Main Valve issues and replacements

# 2025 Passenger Elevator Availability

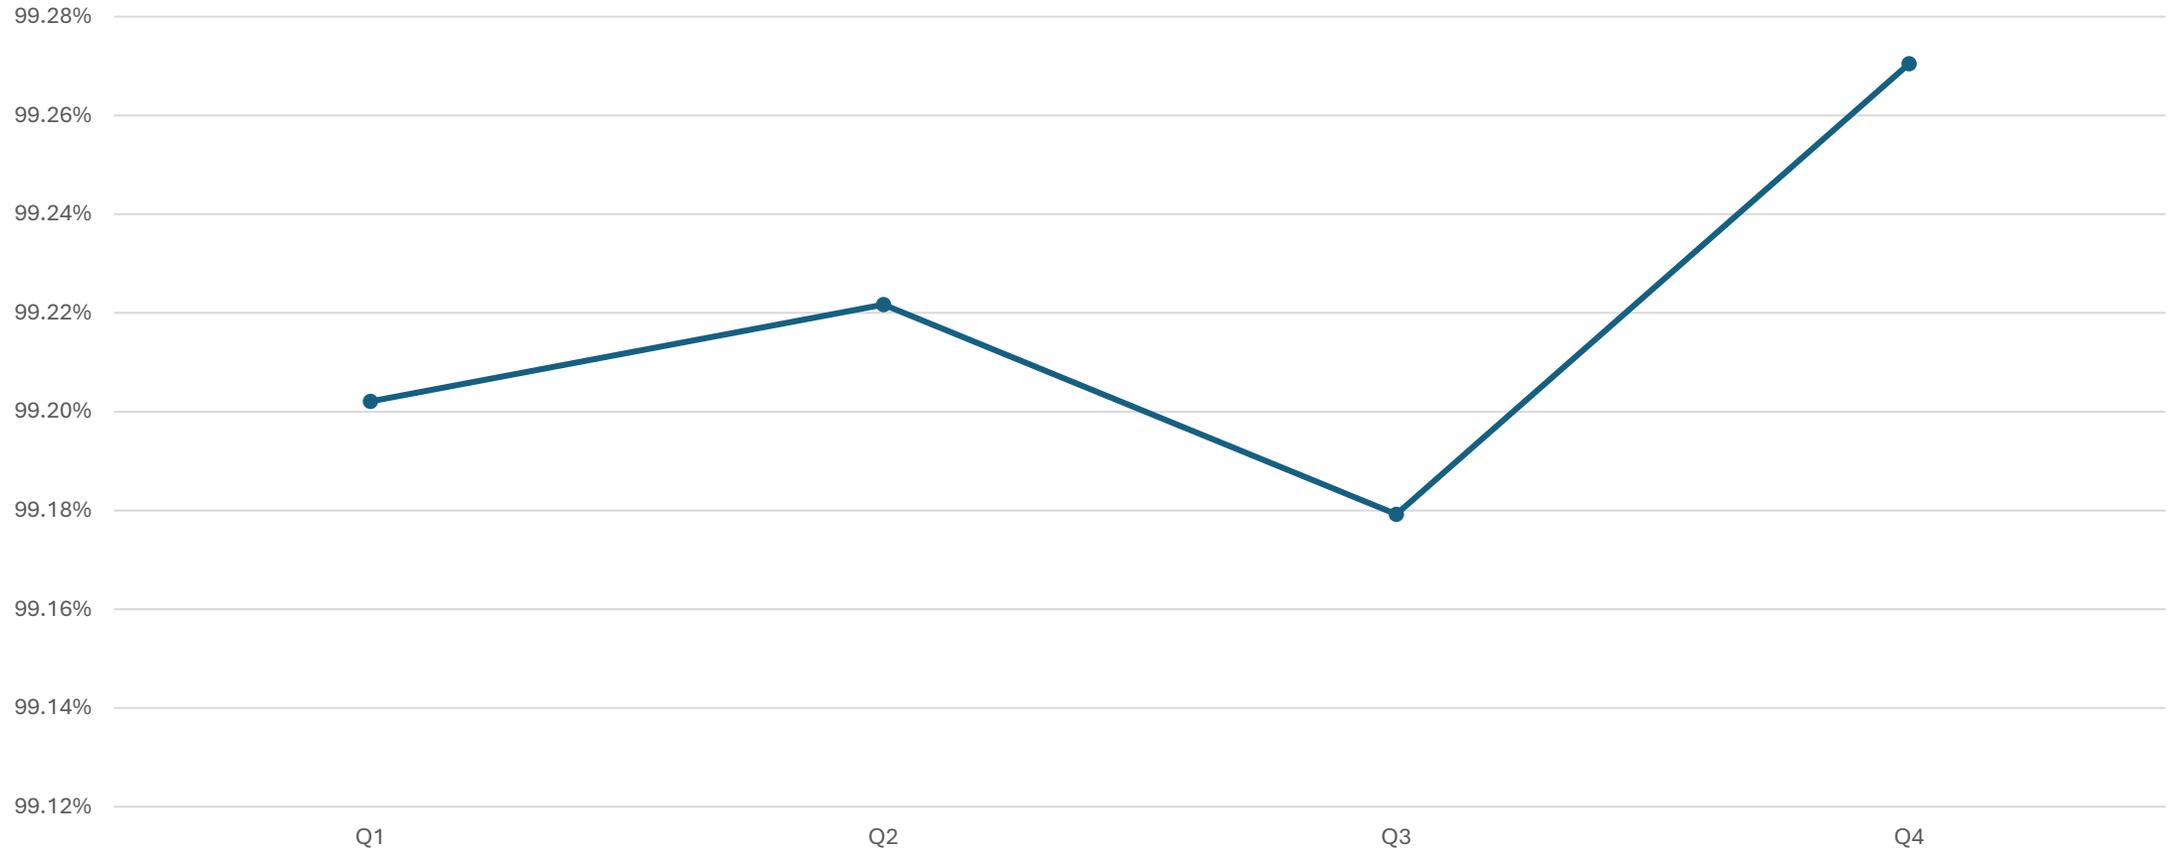

Definition: Availability measures the percent of time that a unit is running and available for customer service.

# 2025 Escalator Availability by Station (Goal 97%)


Branch/Station	Availability	Branch/Station	Availability	Branch/Station	Availability
<b>BABYLON</b>		<b>FAR ROCKAWAY</b>		<b>PENN STATION</b>	
Amityville	97.4%	Valley Stream (4)	95.8%	Penn 33S-ESC-33A (7)	95.5%
Baldwin	97.8%	<b>PORT JEFFERSON</b>		Penn 33S-ESC-33B (8)	96.6%
Bellmore	97.6%	Hicksville A (5)	96.4%	Penn 33S-ESC-33C (9)	96.7%
Copiague	97.9%	Hicksville B	97.9%	Penn 34S-ESC-34A	97.3%
Freeport (1)	84.9%	<b>LONG BEACH</b>		Penn 34S-ESC-34B (10)	96.9%
Lindenhurst	97.5%	Lynbrook (6)	96.7%	Penn 34S-ESC-34C	97.1%
Massapequa	97.6%	<b>HEMPSTEAD</b>		Penn EXI-ESC-9E (11)	94.2%
Massapequa Park	97.9%	Floral Park	97.7%	Penn EXI-ESC-10E (12)	96.6%
Merrick	97.7%	<b>JAMAICA</b>		Penn EXI-ESC-10EW (13)	95.8%
Rockville Centre (2)	96.8%	Jamaica F8	98.1%	Penn EXI-ESC-7EW (14)	79.6%
Seaford (3)	96.4%			Penn EXI-ESC-8EW (15)	83.2%
Wantagh	97.9%			Penn MG-ESC-11MG	97.3%
				Penn MG-ESC-1MG	97.1%
				Penn MG-ESC-2MG (16)	95.8%
				Penn MG-ESC-3MG (17)	96.0%
				Penn MG-ESC-7MG (18)	93.8%
				Penn MG-ESC-8MG (19)	96.0%

- (1) Freeport – Gear box, bull gear replacement and repairs
- (2) Rockville Centre – Frequency drive repairs
- (3) Seaford – Step chain replacement
- (4) Valley Stream – GC warranty issues, repairs
- (5) Hicksville A – Handrail replacement
- (6) Lynbrook – Step chain replacement

- (7) Penn 33A – Emergency Stop Button Activations, Cleandown
- (8) Penn 33B – Emergency Stop Button Activations, Cleandown
- (9) Penn 33C – Emergency Stop Button Activations, Cleandown, Comb plate
- (10) Penn 34B – Emergency Stop Button Activations. Power issues
- (11) Penn 9E – Emergency Stop Button Activations, Reverse phase relay
- (12) Penn 10E – Emergency Stop Button Activations, Power issues
- (13) Penn 10EW – Emergency Stop Button Activations, Power issues
- (14) Penn 7EW – Emergency Stop Button Activations , Brake replacement
- (15) Penn 8EW – Emergency Stop Button Activations, Cleandown

- (16) Penn 2MG – Emergency Stop Button Activations, Water Damage
- (17) Penn 3MG – Emergency Stop Button Activations, Water Damage
- (18) Penn 7MG – Emergency Stop Button Activations, Handrail drive belt, Comb plate
- (19) Penn 8MG – Emergency Stop Button Activations, Cleandown

# 2025 Escalator Availability

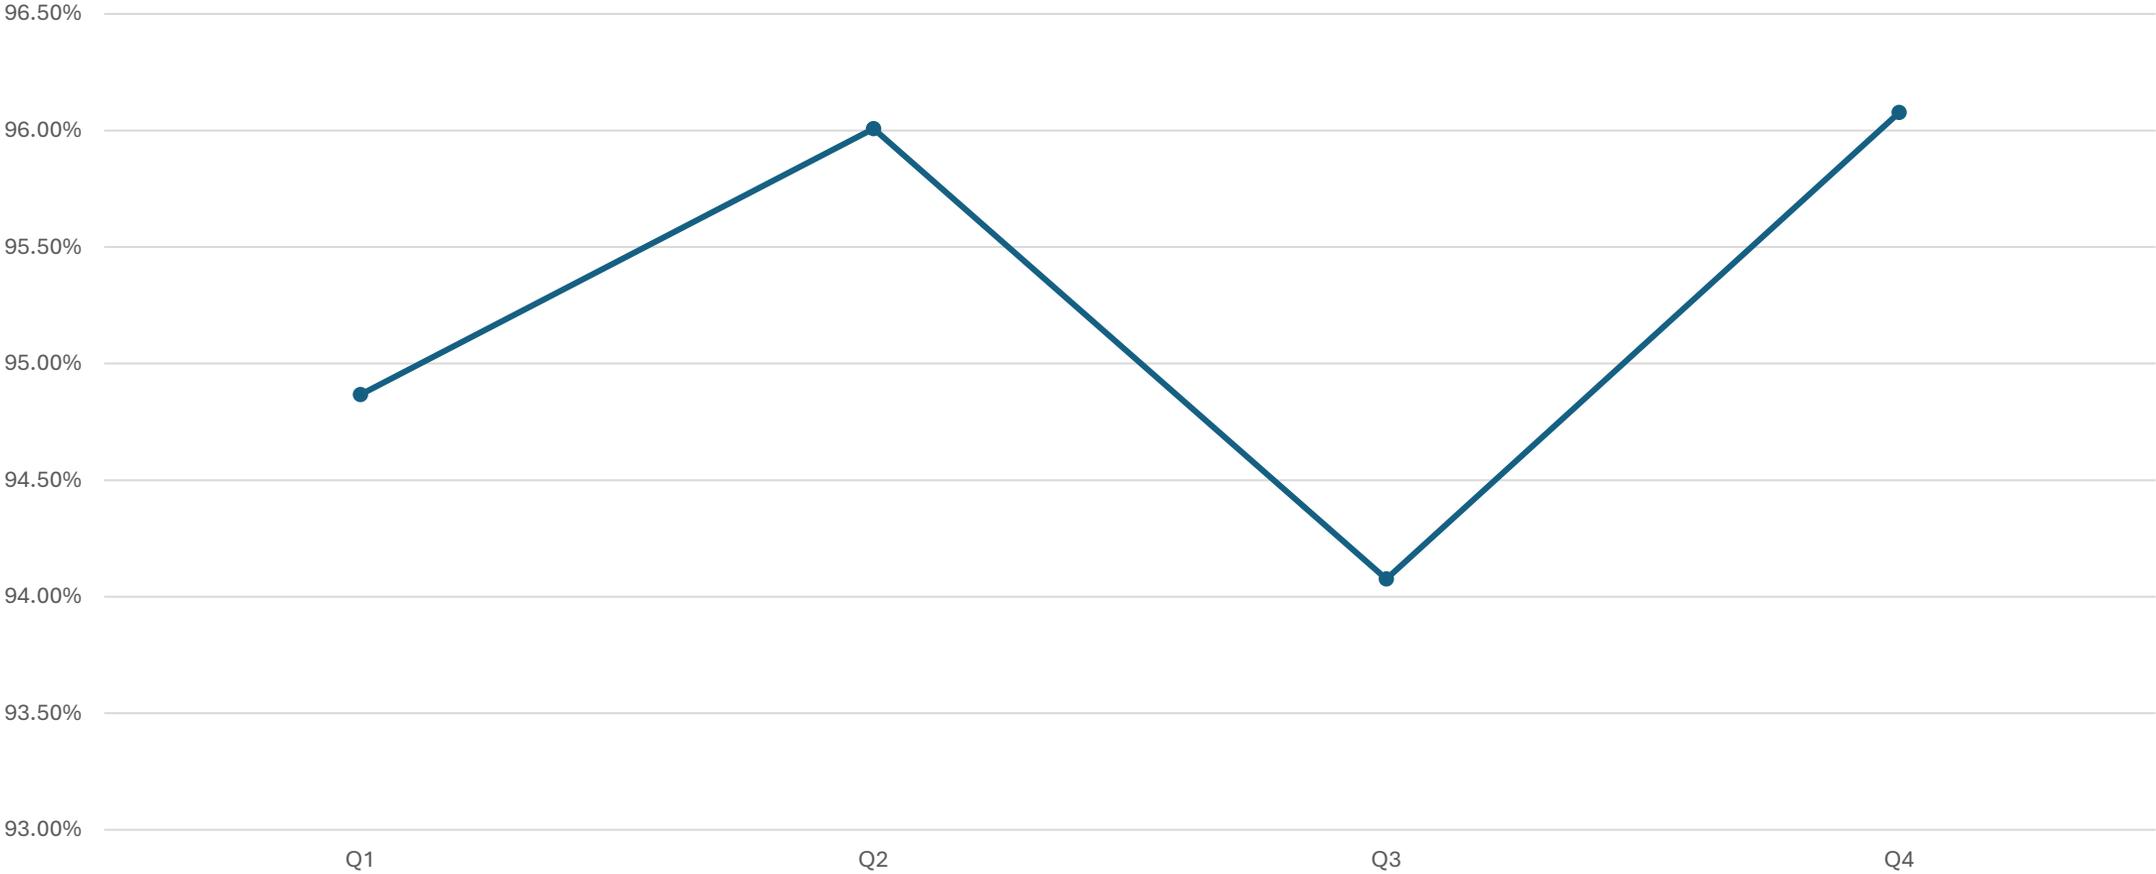

Definition: Availability measures the percent of time that a unit is running and available for customer service.

# 2025 Elevator Customer Injuries/Entrapments by Station

Station Name	Mechanical Injuries	Human Factor Injuries	Entrapment
Carle Place	0	0	1
Jamaica	0	0	1
Lynbrook	0	0	1
Merillon	0	1	1
Mineola	0	0	4
Westbury	0	0	1

**Definitions:**

**Mechanical** includes sudden changes in speed, handrail, alignment. **Human Factor** includes lost balance, encumbrances, Slip/Trip/Fall, pushed/shoved, intoxication, caught between, etc. **Entrapment** is defined when customers are removed from an elevator with special tools or training. These events require intervention but not necessarily involve a customer injury.

**Please note:** These numbers are subject to change based upon additional customer injury reports and claims that may be received after the reporting period end date of December 31, 2025.

(1) Jamaica elevators and escalators maintained by the Port Authority except for platform F equipment.

# 2025 Escalator Customer Injuries by Station

Station Name	Mechanical Injuries	Human Factor Injuries
Copiague	0	1
Freeport	0	1
Hicksville	0	2
Penn Station	0	1

**Definitions:**

**Mechanical** includes sudden changes in speed, handrail, alignment. **Human Factor** includes lost balance, encumbrances, Slip/Trip/Fall, pushed/shoved, intoxication, caught between, etc. **Entrapment** is defined when customers are removed from an elevator with special tools or training. These events require intervention but not necessarily involve a customer injury.

**Please note:** These numbers are subject to change based upon additional customer injury reports and claims that may be received after the reporting period end date of December 31, 2025.

(1) Jamaica elevators and escalators maintained by the Port Authority except for platform F equipment.